



Simec AG

Gärtnereweg 4 B CH-4665 Oftringen  
Telefon +41 62 752 83 08 Fax +41 62 752 83 09  
E-Mail info@simec.ch www.simec.ch

# Test report

Number **C 42806**

**Object of analysis:** Geneza GP Letrozole

**Customer:** \_\_\_\_\_

**Samples:** 1

**Batch:** GP729T, Exp. 02/2019

**Receipt:** 07.04.2016

**Subject:** Letrozole: Assay, Identification

**Method(s):** HPLC

Sample / Analysis:	Method	Status	Result	Specification	complies
<b>Letrozole:</b>					
Identification	HPLC	N	complies	complies	yes
Content	HPLC	N	2.29 mg/tablet	2.5 mg/tablet	-

**Method-status:** G = GMP A = accredited V = generally validated P = validated on product N = not validated  
E = external lab

**Remarks:** The sample(s) mentioned above have been analysed as they have been sent to us by the client. We have not controlled external processes like manufacturing, labelling, sampling, shipping, storage. These results are for information only and do not compensate for correct quality control by the manufacturer/distributor. Generally, pharmaceutical products have to be produced and distributed under full GMP/GDP regime, including GMP-compliant analyses with validated methods. It is not allowed to use this analysis in the context of doping/sports/competitions or any other illegal action, neither by the athlete nor by the tutor/trainer or any other person.

**Signatures:** controlled & released: 

**Staff:** 

**completed:**


03.08.2016

The enclosed results refer exclusively to the object of examination described above.  
The measuring accuracy is available on request. Only handwritten signatures are valid.  
Without written permission, it is not allowed to publish single parts of this report.

page 1 of 1

Report steroid analysis

HPLC: Nr. 6  
 Analysendatum: 03.08.2016 09:06:15 Druckdatum: 03.08.2016 14:11:05  
 Vial: 2 Injektvolumen: 20  
 Probenidentifikation: STD  
 Operator: admin  
 Chrom.-Beding. ACN / Wasser, gradient  
 Säule Nr. 113,  
 Detektion: UV 230nm

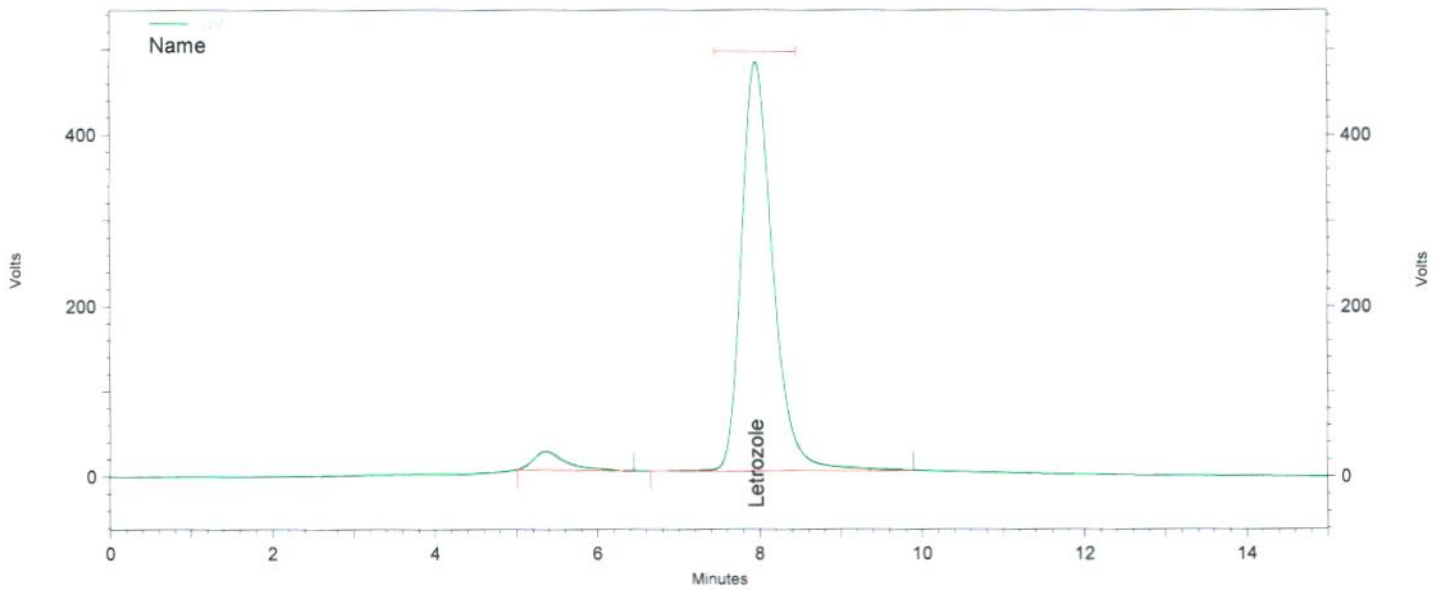

Channel A


UV Results

Name	Time	Area	Amount	Area Percent
Letrozole	7.953	51128316	0.000	95.670
Totals		53442319	0.000	100.000

Daten File: C:\EZChrom Elite\Enterprise\Projects\Simec\Data\2016\August  
 2016\03-08-16\C42806\001\_STD-Rep2.dat  
 Methode: C:\EZChrom Elite\Enterprise\Projects\Simec\Method\Steroide\Letrozole.met

Report steroid analysis

HPLC: Nr. 6  
 Analysendatum: 03.08.2016 09:22:42 Druckdatum: 03.08.2016 14:11:08  
 Vial: 2 Injektvolumen: 20  
 Probenidentifikation: STD  
 Operator: admin  
 Chrom.-Beding. ACN / Wasser, gradient  
 Säule Nr. 113,  
 Detektion: UV 230nm

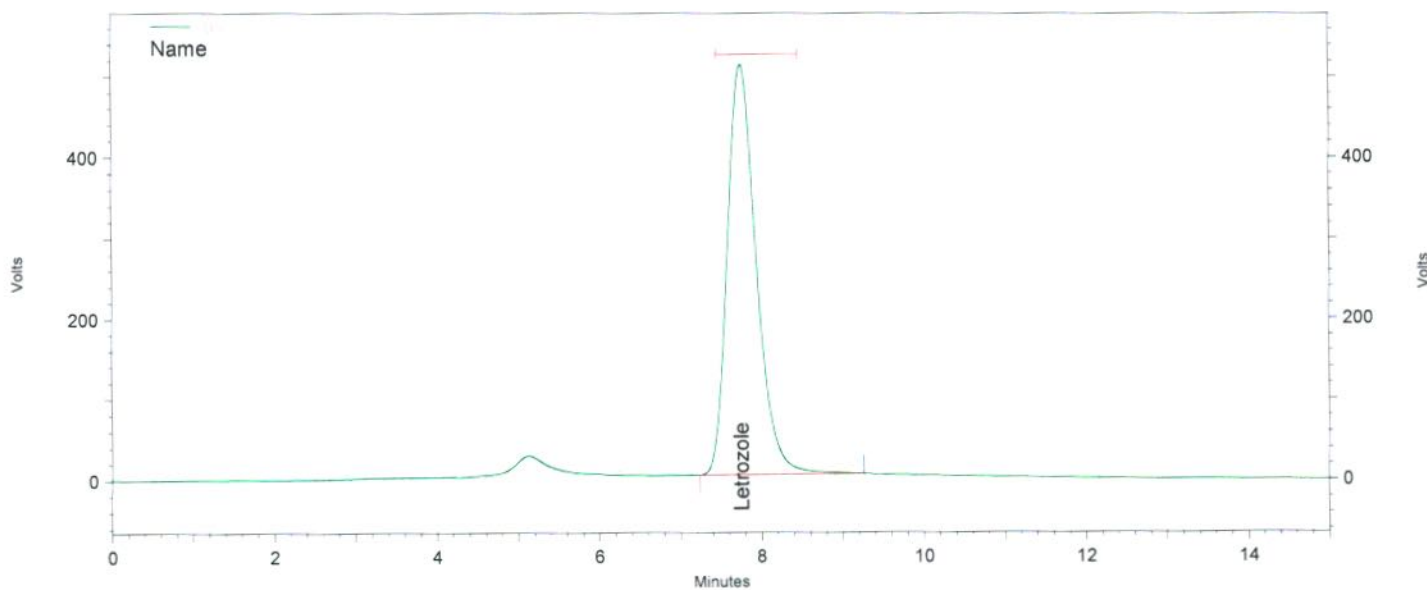

Channel A


UV Results

Name	Time	Area	Amount	Area Percent
Letrozole	7.750	50330224	0.000	100.000
Totals		50330224	0.000	100.000

Daten File: C:\EZChrom Elite\Enterprise\Projects\Simec\Data\2016\August  
 2016\03-08-16\C42806\001\_STD-Rep3.dat  
 Methode: C:\EZChrom Elite\Enterprise\Projects\Simec\Method\Steroide\Letrozole.met

Report steroid analysis

HPLC: Nr. 6  
 Analysendatum: 03.08.2016 09:39:06 Druckdatum: 03.08.2016 14:11:10  
 Vial: 2 Injektvolumen: 20  
 Probenidentifikation: STD  
 Operator: admin  
 Chrom.-Beding. ACN / Wasser, gradient  
 Säule Nr. 113,  
 Detektion: UV 230nm

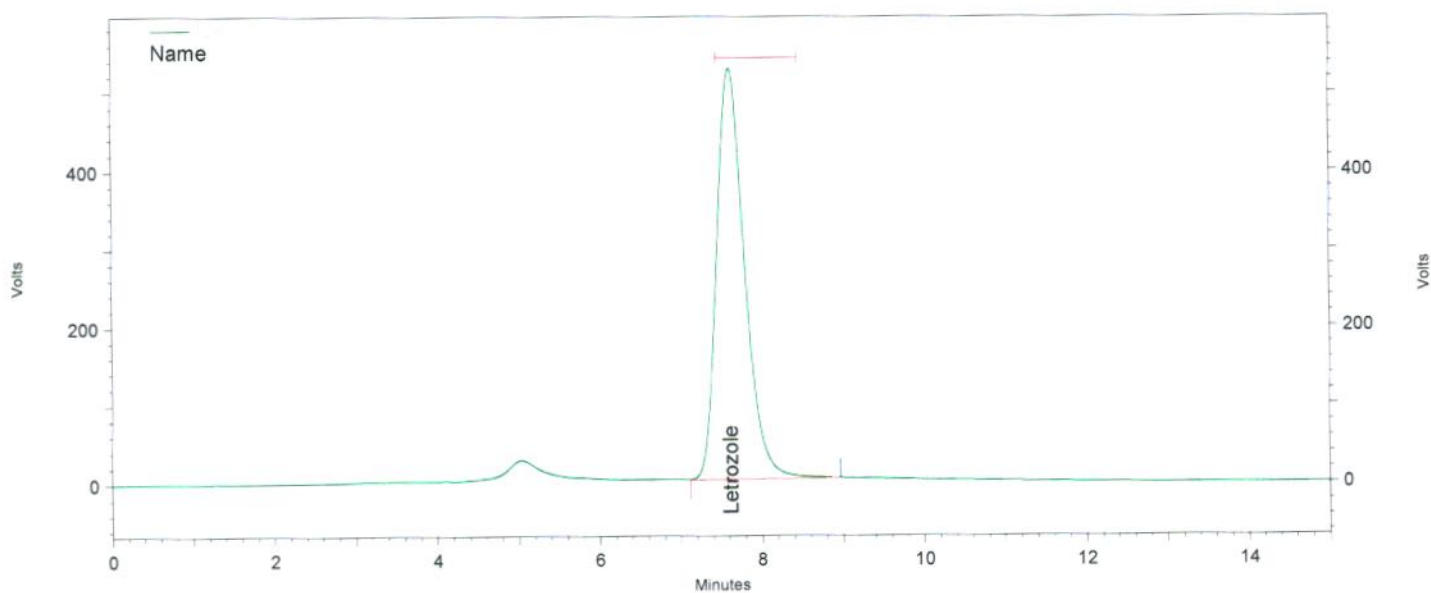

Channel A

UV Results


Name	Time	Area	Amount	Area Percent
Letrozole	7.610	49928810	0.000	100.000
Totals		49928810	0.000	100.000

Daten File: C:\EZChrom Elite\Enterprise\Projects\Simec\Data\2016\August  
 2016\03-08-16\C42806\001\_STD-Rep4.dat  
 Methode: C:\EZChrom Elite\Enterprise\Projects\Simec\Method\Steroide\Letrozole.met

Report steroid analysis

HPLC: Nr. 6  
 Analysendatum: 03.08.2016 09:55:34  
 Vial: 2  
 Probenidentifikation: STD  
 Operator: admin  
 Chrom.-Beding. ACN / Wasser, gradient  
 Säule Nr. 113,  
 Detektion: UV 230nm

Druckdatum: 03.08.2016 14:11:12  
 Injektvolumen: 20

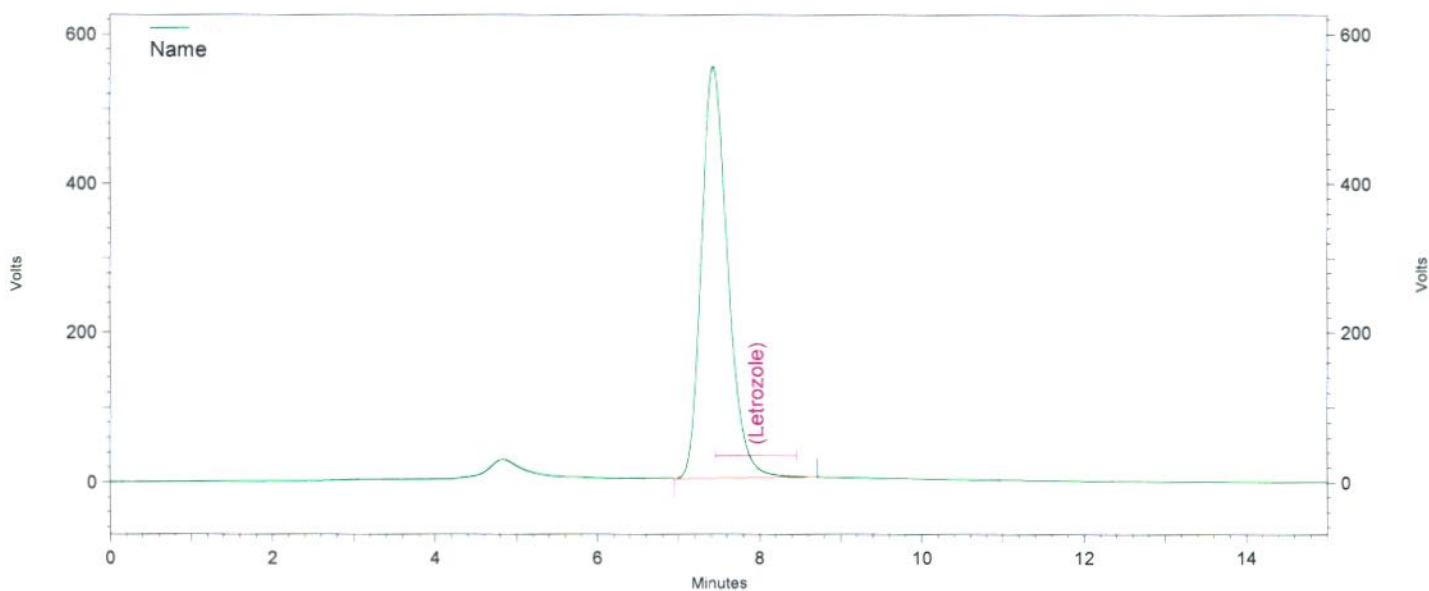

Channel A

UV Results				
Name	Time	Area	Amount	Area Percent
Letrozole	7.430	49854838	0.000	100.000
			0.000 BDL	


Totals		49854838	0.000	100.000
--------	--	----------	-------	---------

Daten File: C:\EZChrom Elite\Enterprise\Projects\Simec\Data\2016\August  
 2016\03-08-16\C42806\001\_STD-Rep5.dat  
 Methode: C:\EZChrom Elite\Enterprise\Projects\Simec\Method\Steroide\Letrozole.met

Report steroid analysis

HPLC: Nr. 6  
 Analysendatum: 03.08.2016 10:12:02  
 Vial: 2  
 Probenidentifikation: STD  
 Operator: admin  
 Chrom.-Beding. ACN / Wasser, gradient  
 Säule Nr. 113,  
 Detektion: UV 230nm

Druckdatum: 03.08.2016 14:11:14  
 Injektvolumen: 20

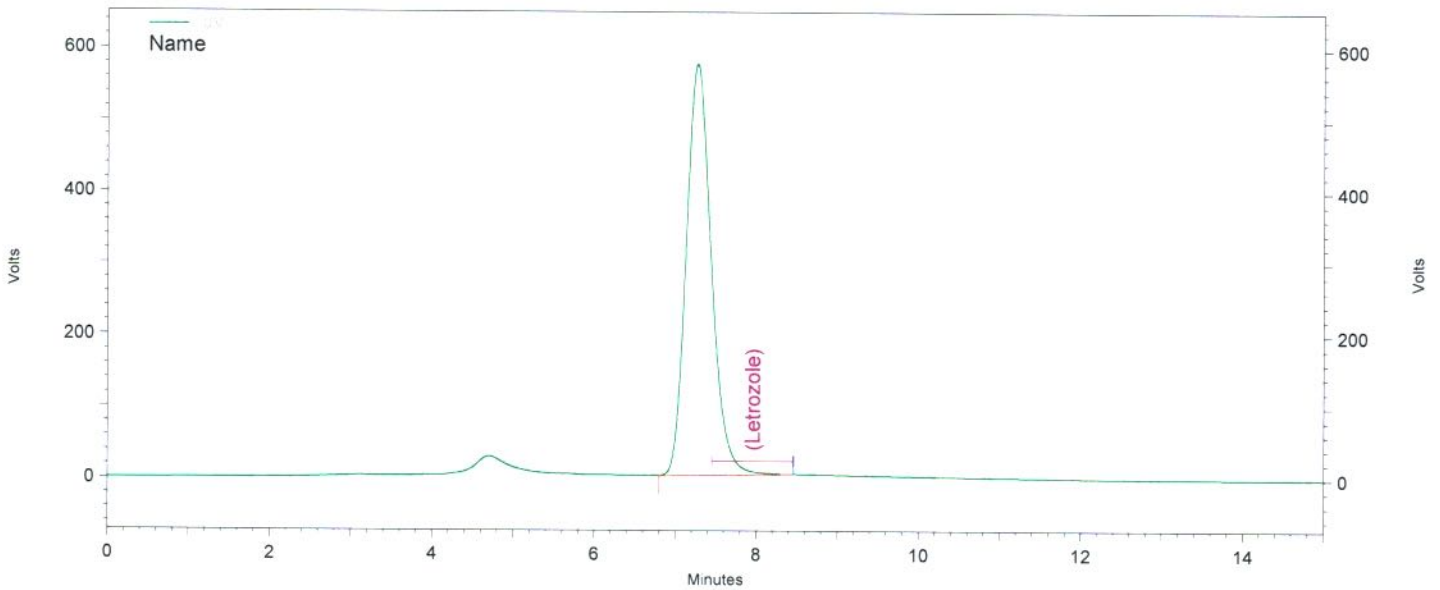

Channel A

UV Results


Name	Time	Area	Amount	Area Percent
Letrozole	7.267	49678949	0.000 0.000 BDL	100.000
Totals		49678949	0.000	100.000

Daten File: C:\EZChrom Elite\Enterprise\Projects\Simec\Data\2016\August  
 2016\03-08-16\C42806\001\_STD-Rep6.dat  
 Methode: C:\EZChrom Elite\Enterprise\Projects\Simec\Method\Steroide\Letrozole.met



Report steroid analysis

HPLC: Nr. 6  
 Analysendatum: 03.08.2016 10:44:45 Druckdatum: 03.08.2016 14:11:18  
 Vial: 3 Injektvolumen: 20  
 Probenidentifikation: C42806 A  
 Operator: admin  
 Chrom.-Beding. ACN / Wasser, gradient  
 Säule Nr. 113,  
 Detektion: UV 230nm

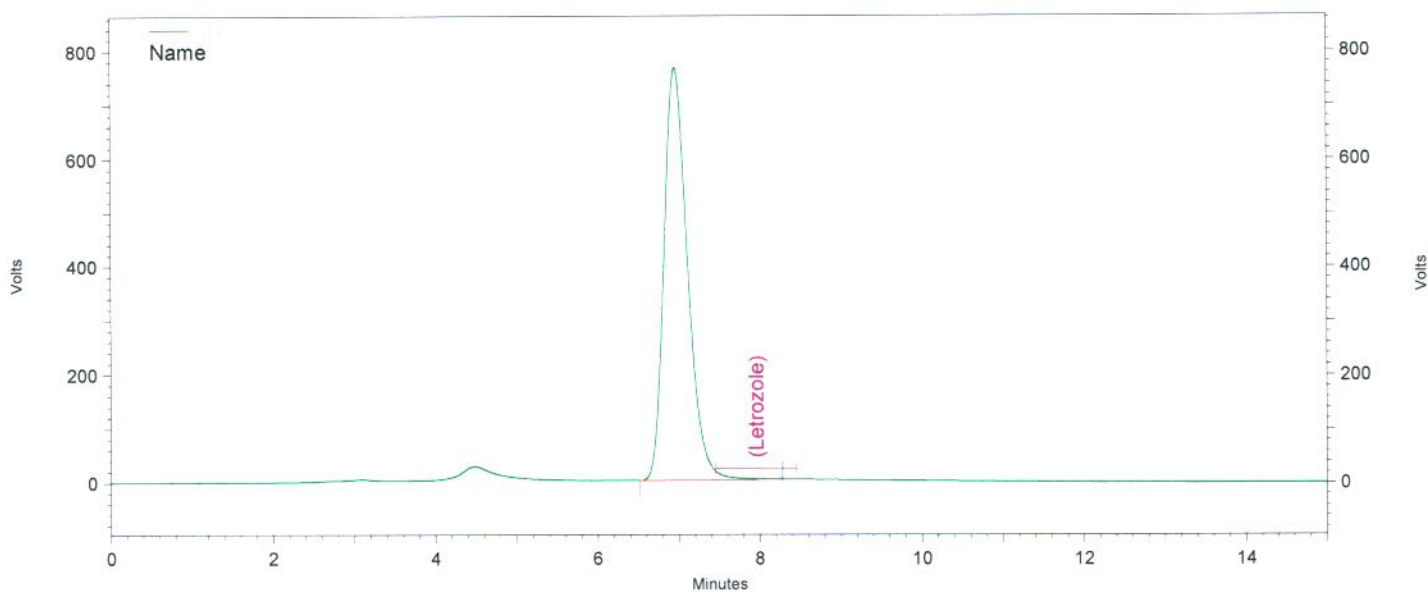

Channel A

UV Results

Name	Time	Area	Amount	Area Percent
Letrozole	6.953	61321216	0.000 0.000 BDL	100.000


Totals		61321216	0.000	100.000
--------	--	----------	-------	---------

Daten File: C:\EZChrom Elite\Enterprise\Projects\Simec\Data\2016\August 2016\03-08-16\C42806\003\_C42806  
 A-Rep1.dat  
 Methode: C:\EZChrom Elite\Enterprise\Projects\Simec\Method\Steroide\Letrozole.met

Report steroid analysis

HPLC: Nr. 6  
 Analysendatum: 03.08.2016 11:01:12  
 Vial: 3  
 Probenidentifikation: C42806 A  
 Operator: admin  
 Chrom.-Beding. ACN / Wasser, gradient  
 Säule Nr. 113,  
 Detektion: UV 230nm

Druckdatum: 03.08.2016 14:11:20  
 Injektvolumen: 20

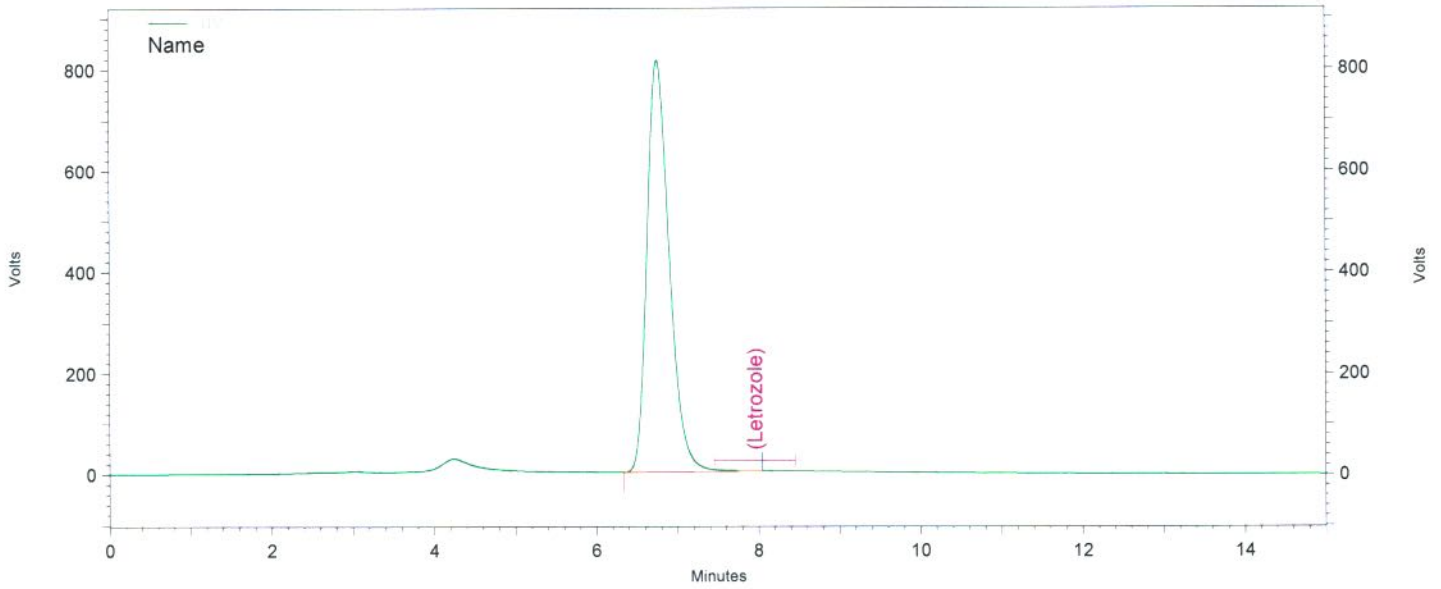

Channel A

UV Results				
Name	Time	Area	Amount	Area Percent
Letrozole	6.753	62029323	0.000 0.000 BDL	100.000
Totals		62029323	0.000	100.000


Daten File: C:\EZChrom Elite\Enterprise\Projects\Simec\Data\2016\August 2016\03-08-16\C42806\003\_C42806  
 A-Rep2.dat  
 Methode: C:\EZChrom Elite\Enterprise\Projects\Simec\Method\Steroide\Letrozole.met



Report steroid analysis

HPLC: Nr. 6  
 Analysendatum: 03.08.2016 11:17:34  
 Vial: 3  
 Probenidentifikation: C42806 A  
 Operator: admin  
 Chrom.-Beding. ACN / Wasser, gradient  
 Säule Nr. 113,  
 Detektion: UV 230nm

Druckdatum: 03.08.2016 14:11:22  
 Injektvolumen: 20

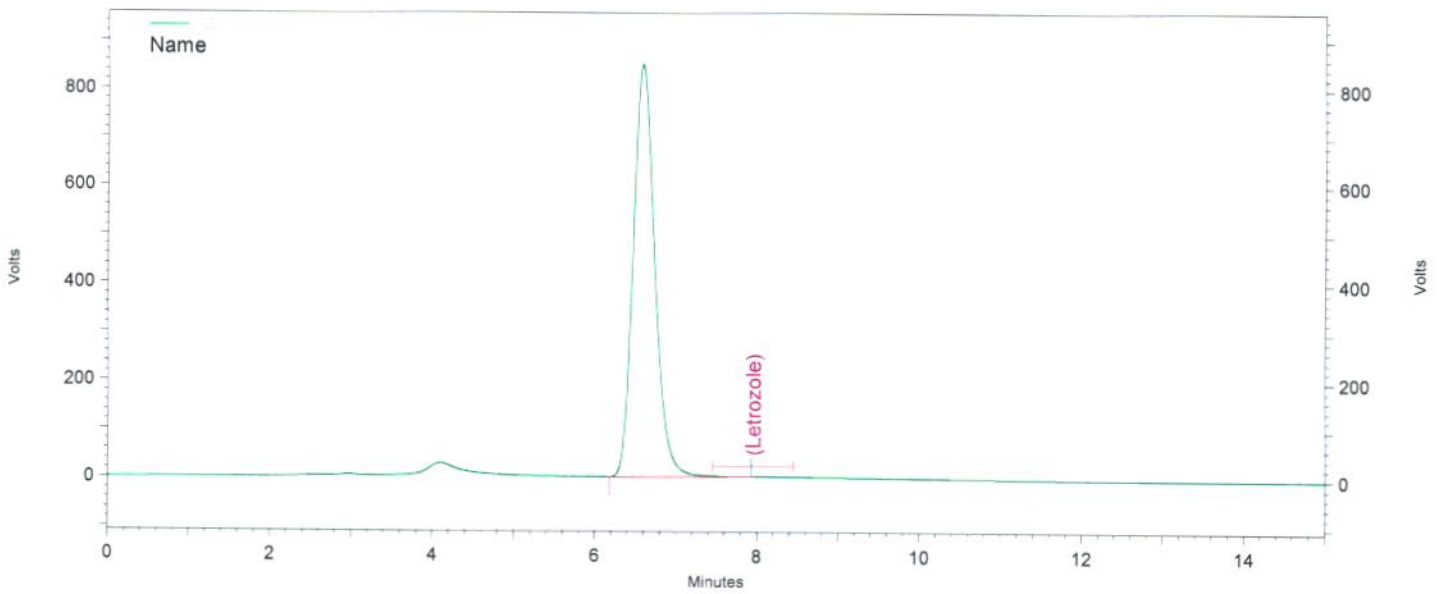

Channel A

UV Results

Name	Time	Area	Amount	Area Percent
Letrozole	6.580	62158936	0.000 0.000 BDL	100.000


Totals		62158936	0.000	100.000
--------	--	----------	-------	---------

Daten File: C:\EZChrom Elite\Enterprise\Projects\Simec\Data\2016\August 2016\03-08-16\C42806\003\_C42806  
 A-Rep3.dat  
 Methode: C:\EZChrom Elite\Enterprise\Projects\Simec\Method\Steroide\Letrozole.met

Report steroid analysis

HPLC: Nr. 6  
 Analysendatum: 03.08.2016 11:34:00  
 Vial: 4  
 Probenidentifikation: C42806 B  
 Operator: admin  
 Chrom.-Beding. ACN / Wasser, gradient  
 Säule Nr. 113,  
 Detektion: UV 230nm

Druckdatum: 03.08.2016 14:11:25  
 Injektvolumen: 20

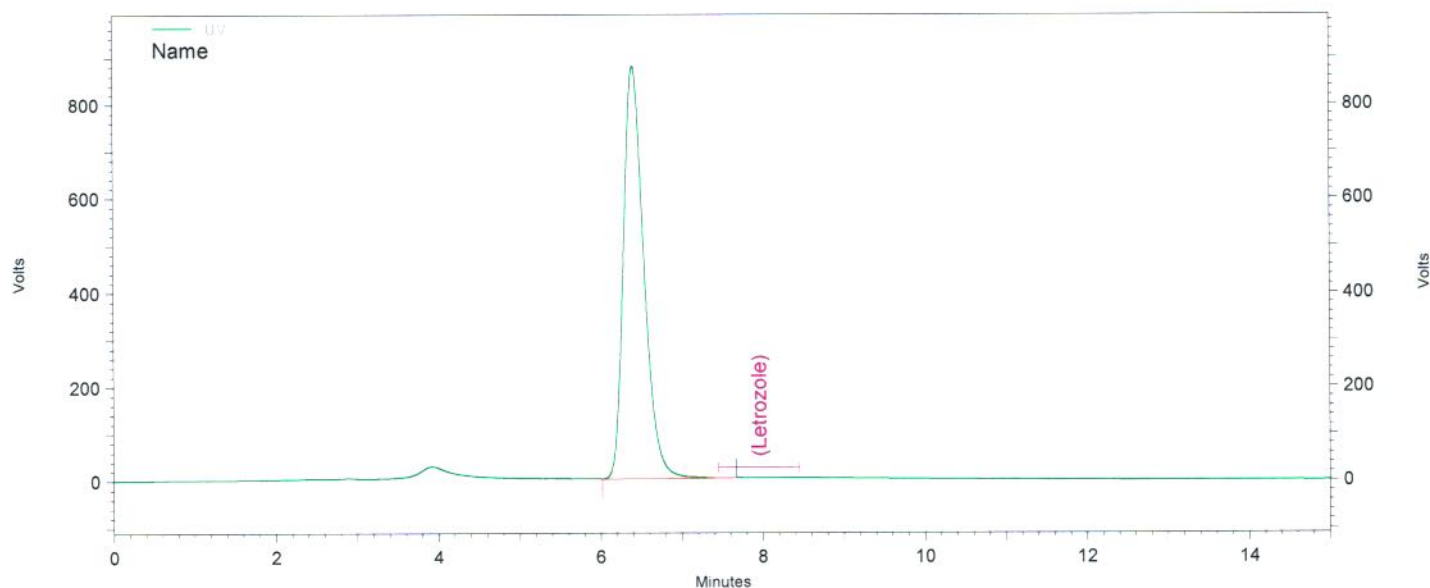

Channel A

UV Results


Name	Time	Area	Amount	Area Percent
Letrozole	6.403	61249772	0.000 BDL	100.000

Totals		61249772	0.000	100.000
--------	--	----------	-------	---------

Daten File: C:\EZChrom Elite\Enterprise\Projects\Simec\Data\2016\August 2016\03-08-16\C42806\004\_C42806  
 B-Rep1.dat  
 Methode: C:\EZChrom Elite\Enterprise\Projects\Simec\Method\Steroide\Letrozole.met

Report steroid analysis

HPLC: Nr. 6  
 Analysendatum: 03.08.2016 11:50:18 Druckdatum: 03.08.2016 14:11:27  
 Vial: 4 Injektvolumen: 20  
 Probenidentifikation: C42806 B  
 Operator: admin  
 Chrom.-Beding. ACN / Wasser, gradient  
 Säule Nr. 113,  
 Detektion: UV 230nm

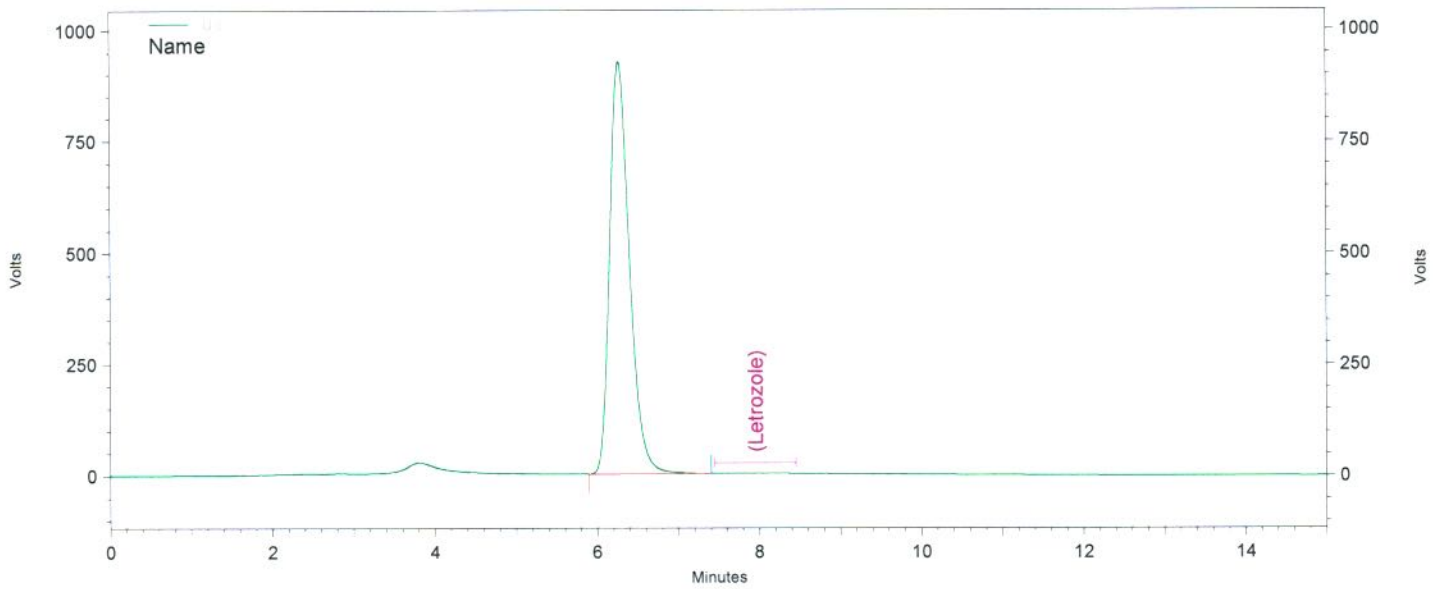

Channel A

UV Results

Name	Time	Area	Amount	Area Percent
Letrozole	6.270	62352258	0.000 0.000 BDL	100.000


Totals		62352258	0.000	100.000
--------	--	----------	-------	---------

Daten File: C:\EZChrom Elite\Enterprise\Projects\Simec\Data\2016\August 2016\03-08-16\C42806\004\_C42806  
 B-Rep2.dat  
 Methode: C:\EZChrom Elite\Enterprise\Projects\Simec\Method\Steroide\Letrozole.met

Report steroid analysis

HPLC: Nr. 6  
 Analysendatum: 03.08.2016 12:06:44  
 Vial: 4  
 Probenidentifikation: C42806 B  
 Operator: admin  
 Chrom.-Beding. ACN / Wasser, gradient  
 Säule Nr. 113,  
 Detektion: UV 230nm

Druckdatum: 03.08.2016 14:11:29  
 Injektvolumen: 20

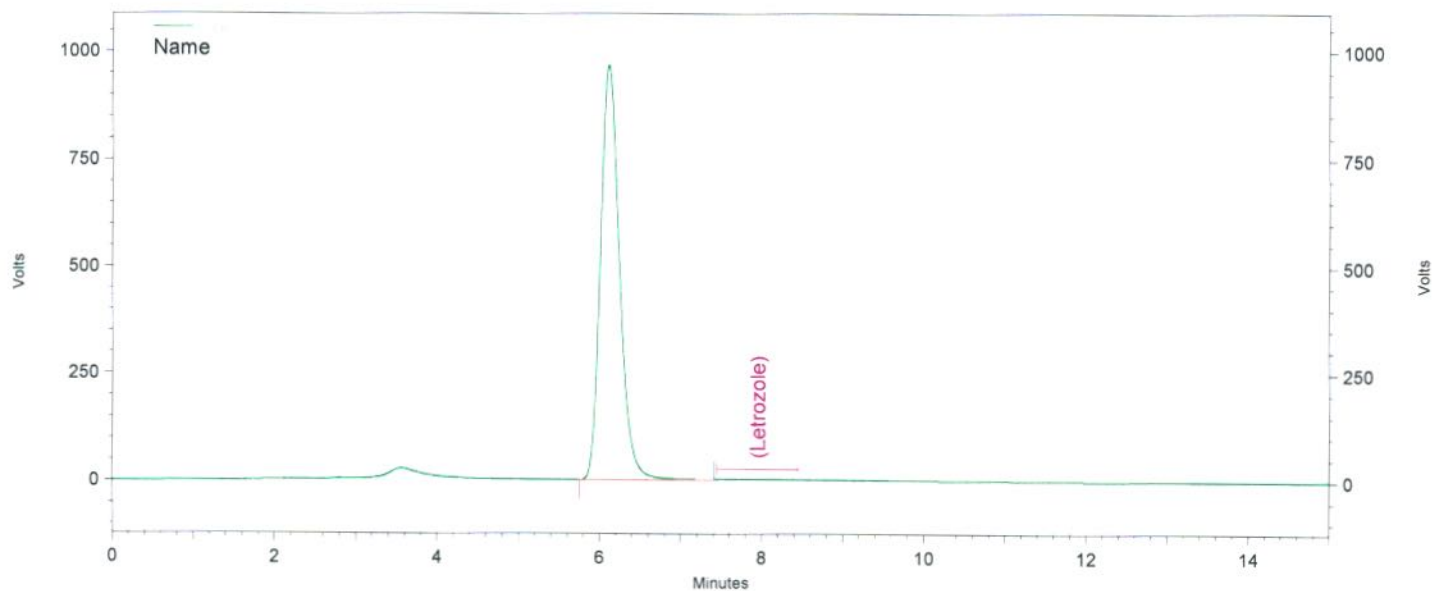

Channel A

UV Results

Name	Time	Area	Amount	Area Percent
Letrozole	6.110	62450392	0.000 0.000 BDL	100.000

Totals		62450392	0.000	100.000
--------	--	----------	-------	---------

Daten File: C:\EZChrom Elite\Enterprise\Projects\Simec\Data\2016\August 2016\03-08-16\C42806\004\_C42806  
 B-Rep3.dat  
 Methode: C:\EZChrom Elite\Enterprise\Projects\Simec\Method\Steroide\Letrozole.met